



NOTE: TA1 AND PROBE-T1 ARE
OPTIONAL AND ARE USED TO
MONITOR DISCHARGE
TEMPERATURE.

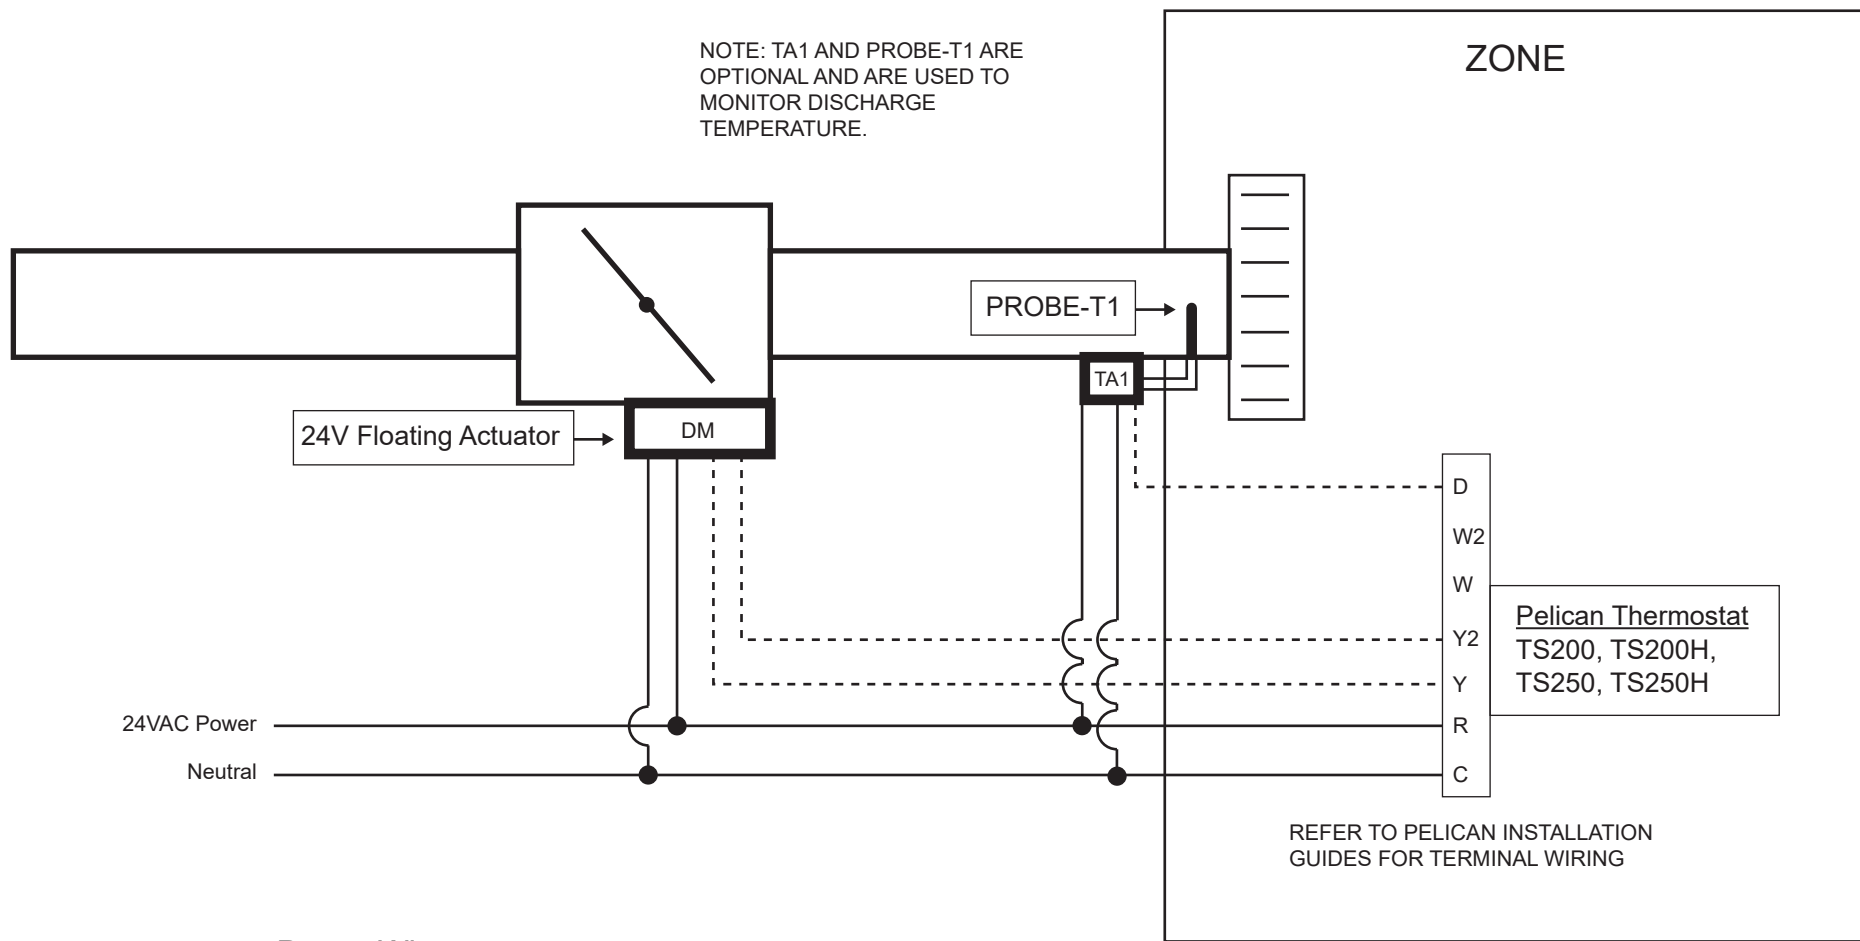

Power Wire ———

24V Control Wire - - - - -

Single Duct 24VAC Floating Actuator

DRAWN BY	CHECKED	DATE	SCALE	SHEET NO.
		02/18/2016	NTA	1 of 1