


NOTE: TA1 AND PROBE-T1 ARE
OPTIONAL AND ARE USED TO
MONITOR DISCHARGE
TEMPERATURE.

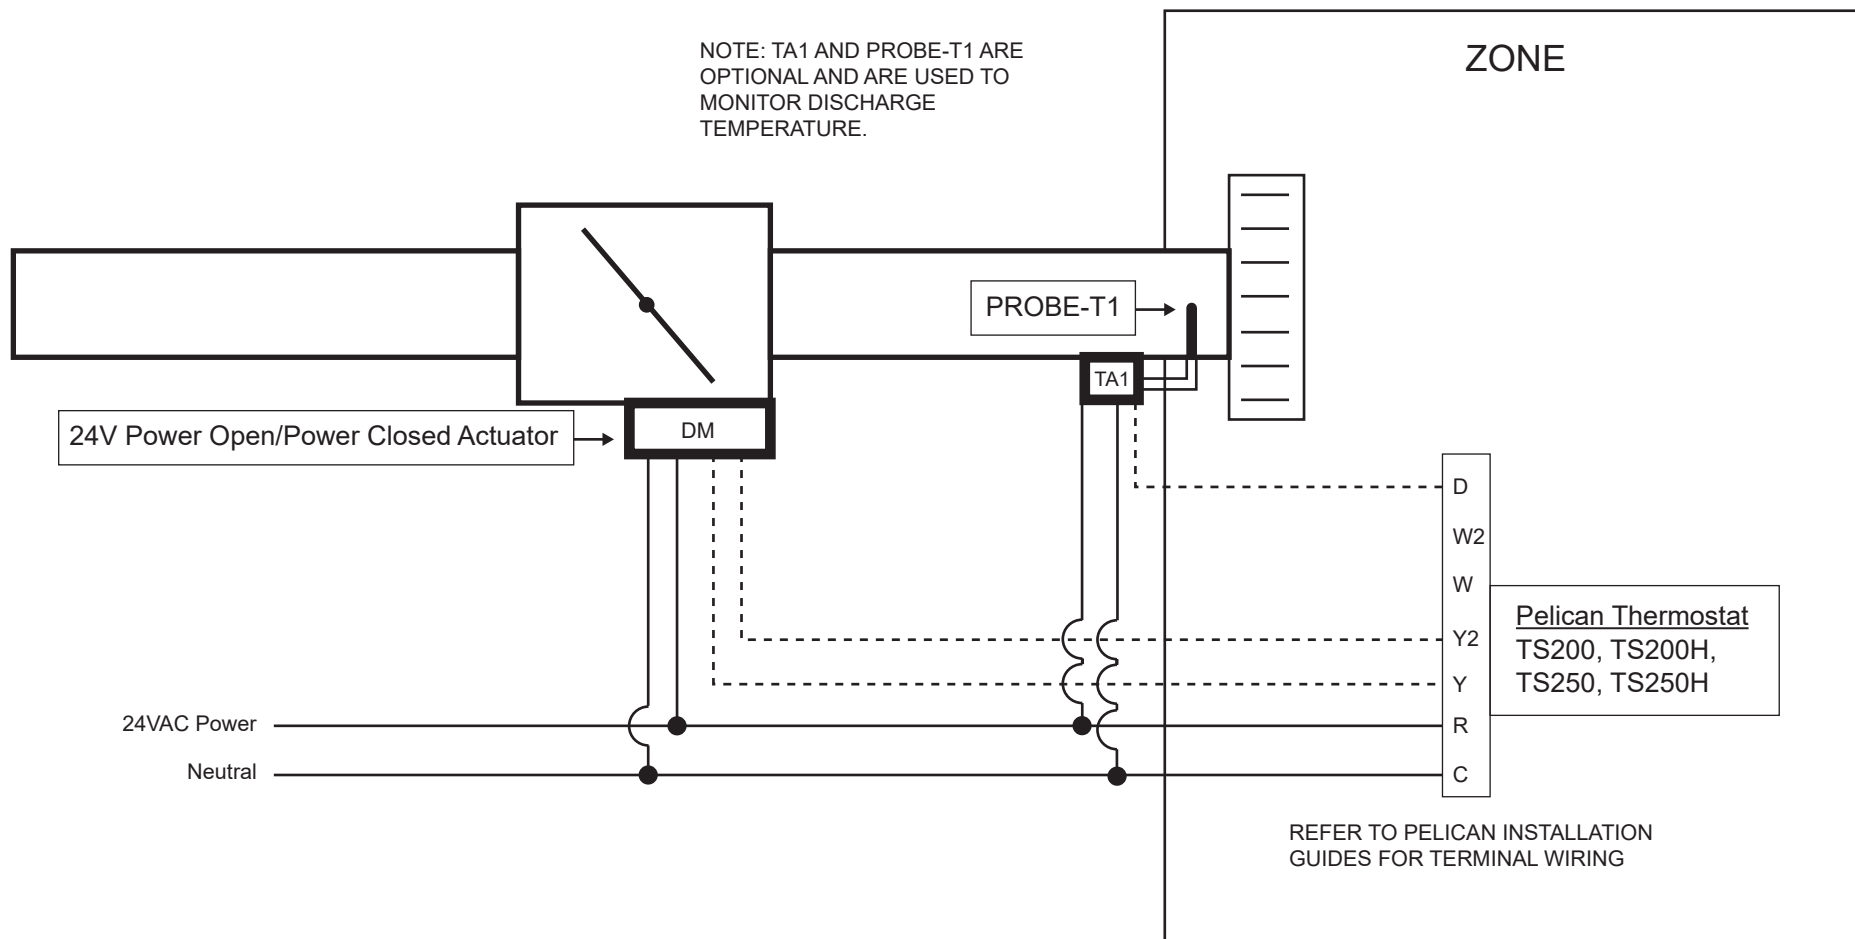

Power Wire ———

24V Control Wire - - - - -